


SAMPLE MONITORING SITES

PARKLAND LIGHT & WATER
INTERTIE W/
SUMMIT WATER & SUPPLY CO

Summit Water does not
inject Fluoride. Water
purchased from Parkland
Light & Water is
Fluoridated at this time.

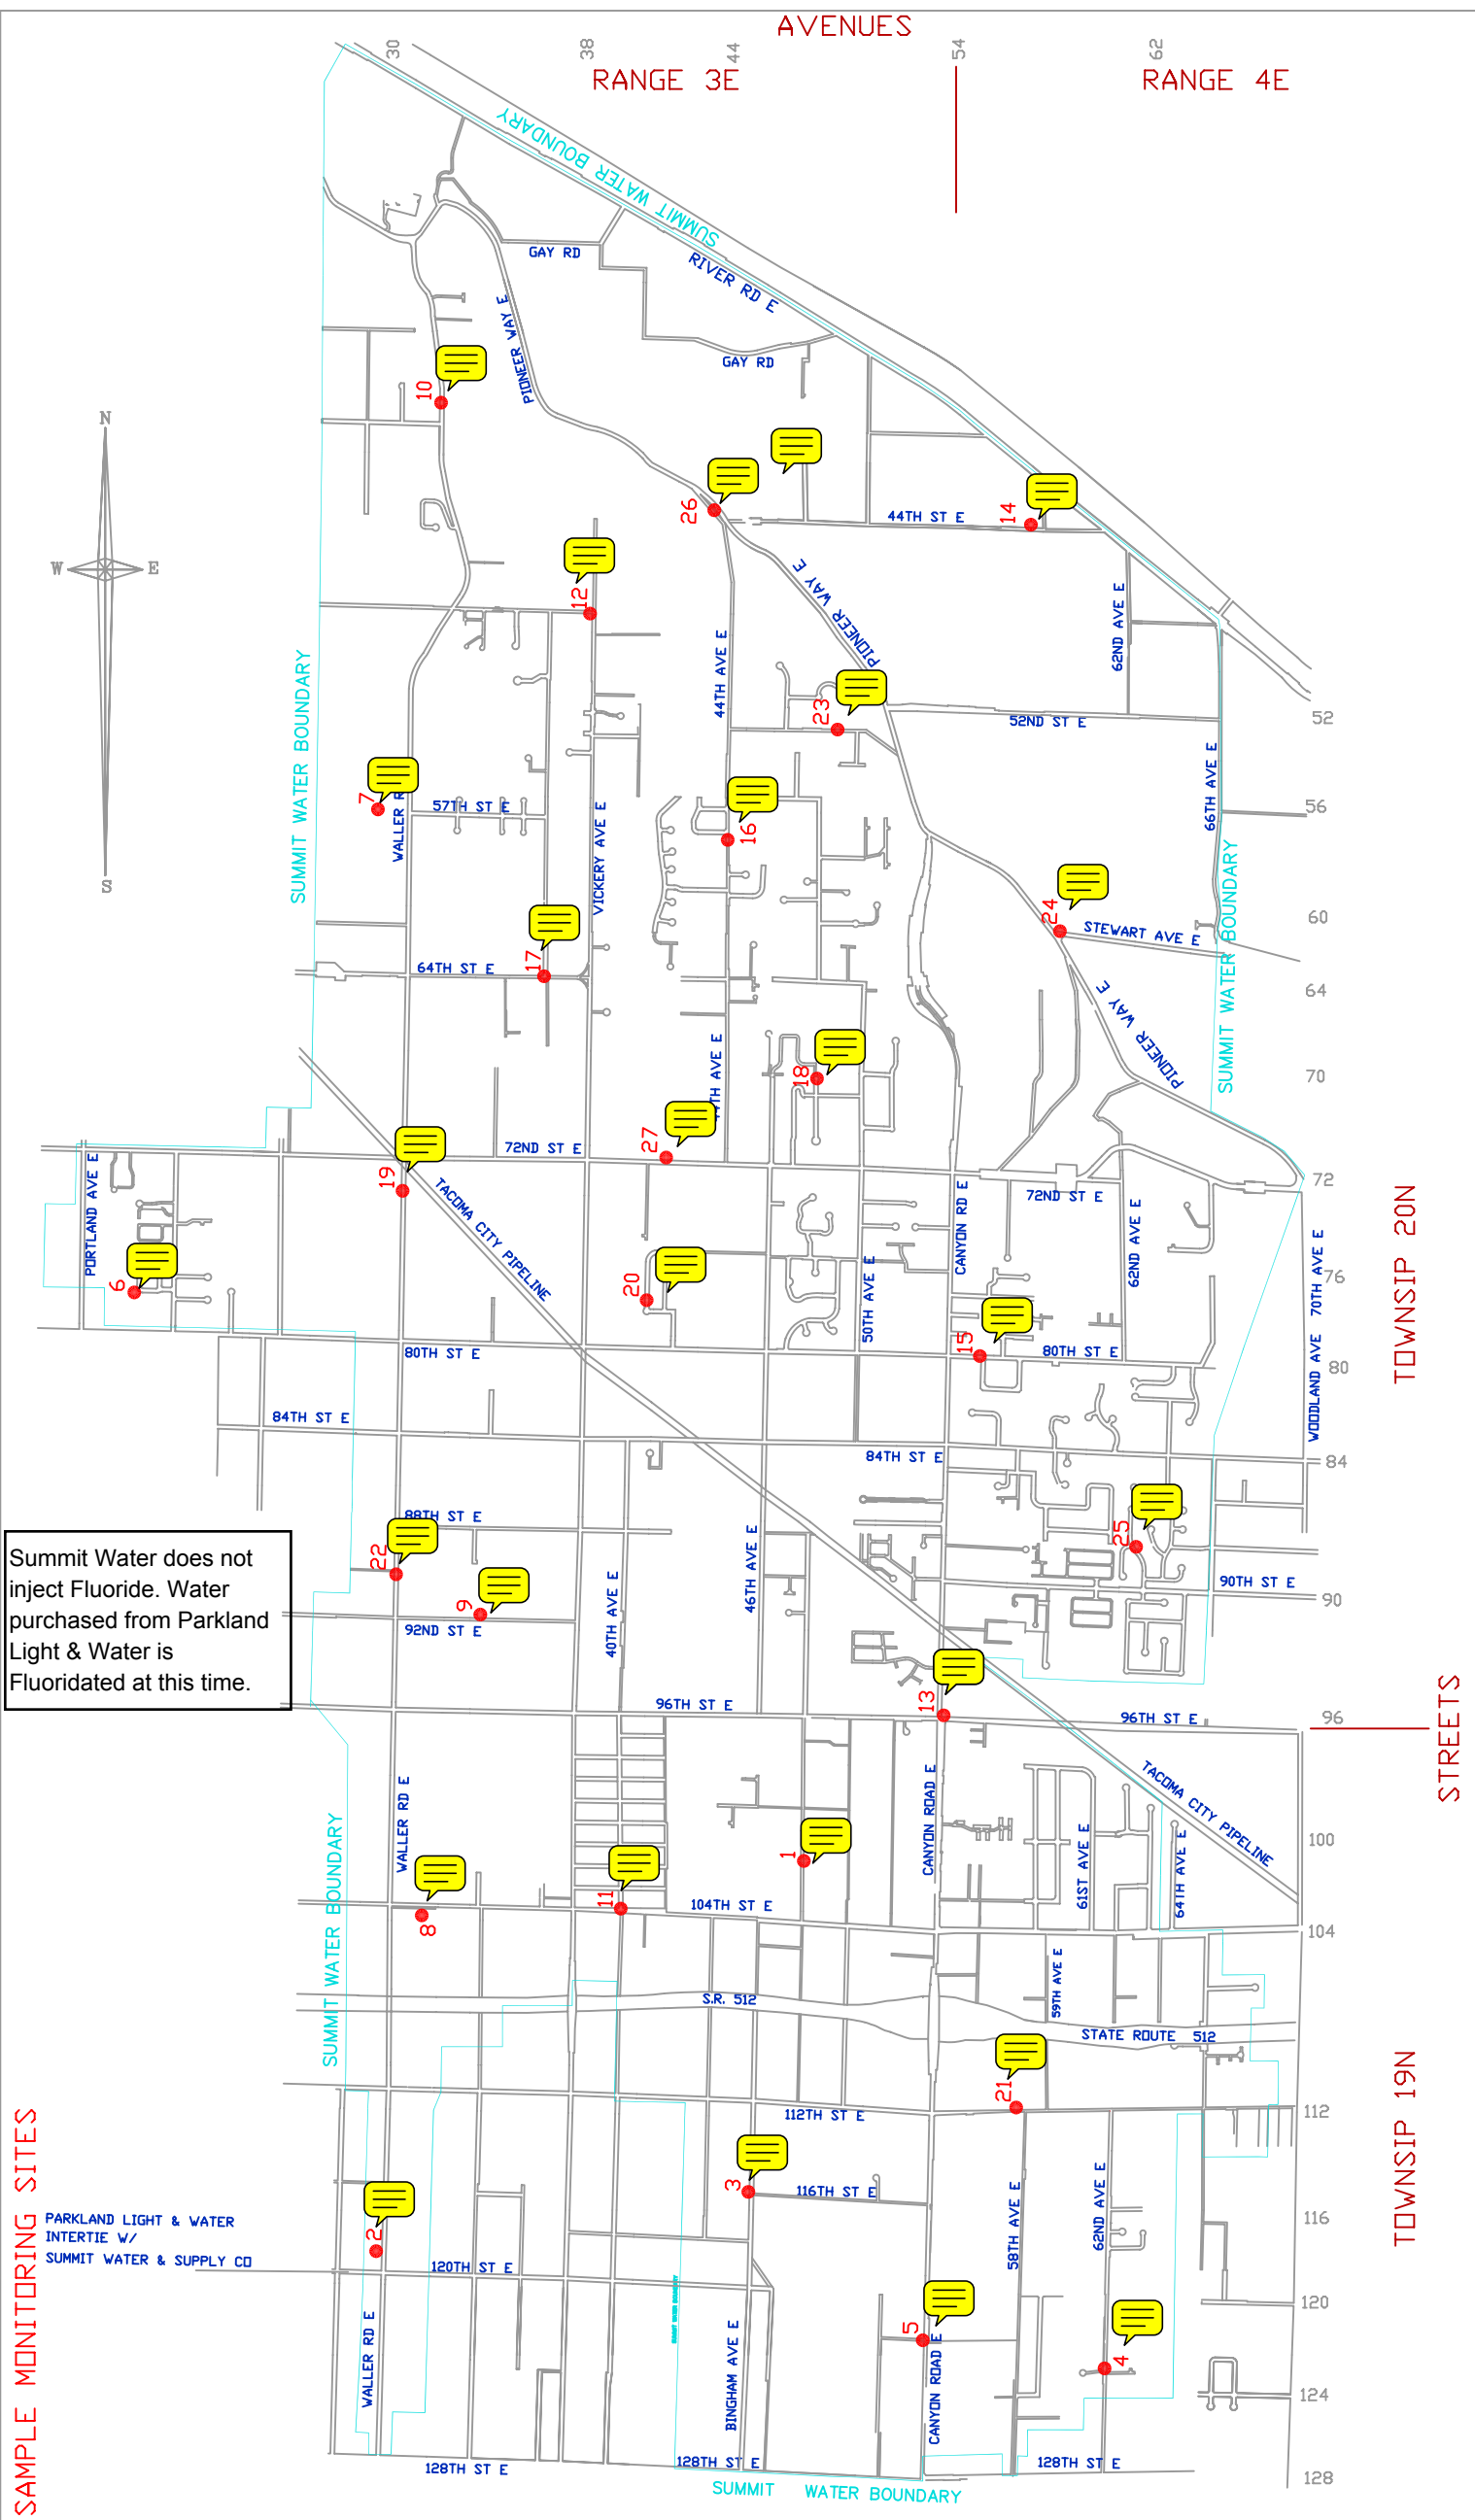

AVENUES
RANGE 3E 144 54 62 RANGE 4E

TOWNSHIP 20N

STREETS

TOWNSHIP 19N