


TYPICALS ARE SUBJECT TO CHANGE BASED ON SWSO APPROVED PROJECT PLANS
 SUBJECT TO CHANGE WITHOUT NOTICE, CHECK WITH SWSO OFFICE FOR LATEST

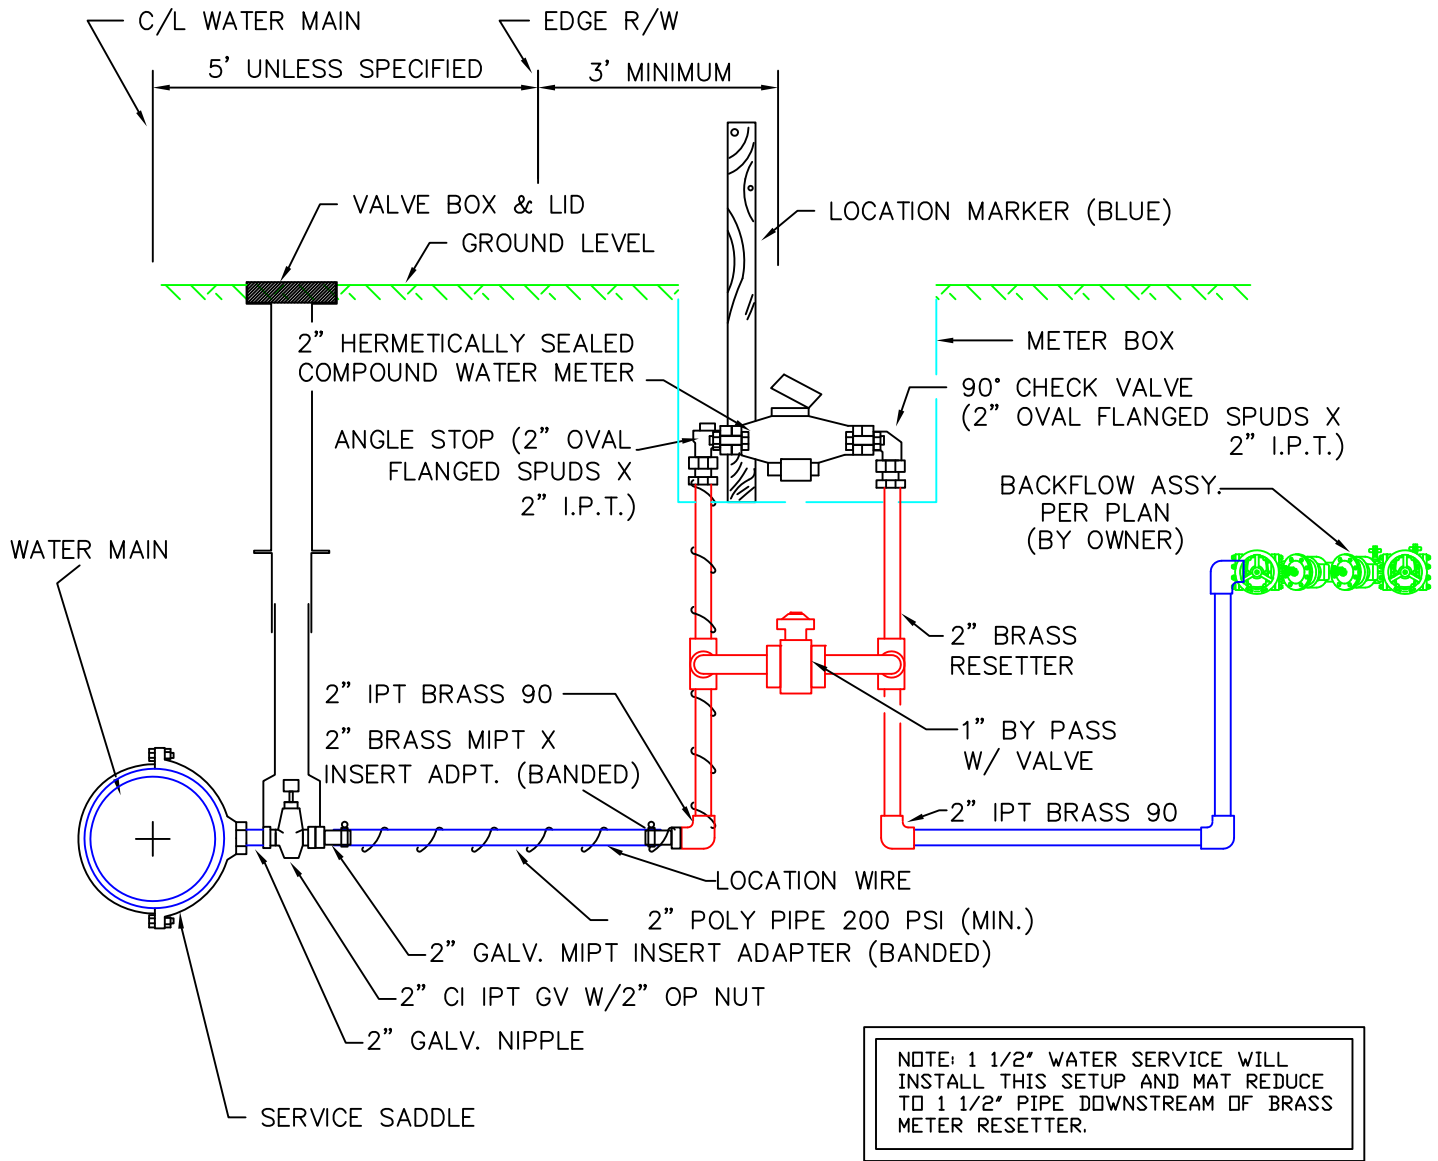

NOTE: 1 1/2" WATER SERVICE WILL
 INSTALL THIS SETUP AND MAY REDUCE
 TO 1 1/2" PIPE DOWNSTREAM OF BRASS
 METER RESETTER.

SPECIFICATIONS:

1. METER BOX SHALL BE PER PLAN TYPE 20" X 32" X 12" DEEP WITH 1/4" STEEL LID W/ READER DOOR.
2. 2" POLY-PIPE SHALL BE WRAPPED WITH 14 GAUGE SOLID COPPER INSULATED WIRE FOR LOCATING PURPOSES.
3. EACH SERVICE LINE SHALL HAVE A BLUE 2"X2" OR 2"X4" STUD EXTENDING A MINIMUM OF TWO (2) FEET ABOVE GROUND LEVEL. STUD TO BE USED AS A TEMPORARY LOCATION MARKER.
4. ALL WATER SERVICE CROSSINGS SHALL BE IN-CASED IN THREE (3) INCH CLASS 160 PVC PIPE.

TYPICAL 2" WATER SERVICE INSTALLATION