


TYPICAL AIR RELEASE

DRAWING SUBJECT TO
CHANGE WITHOUT NOTICE.
CONTACT SUMMIT WATER
FOR LATEST DETAILS.

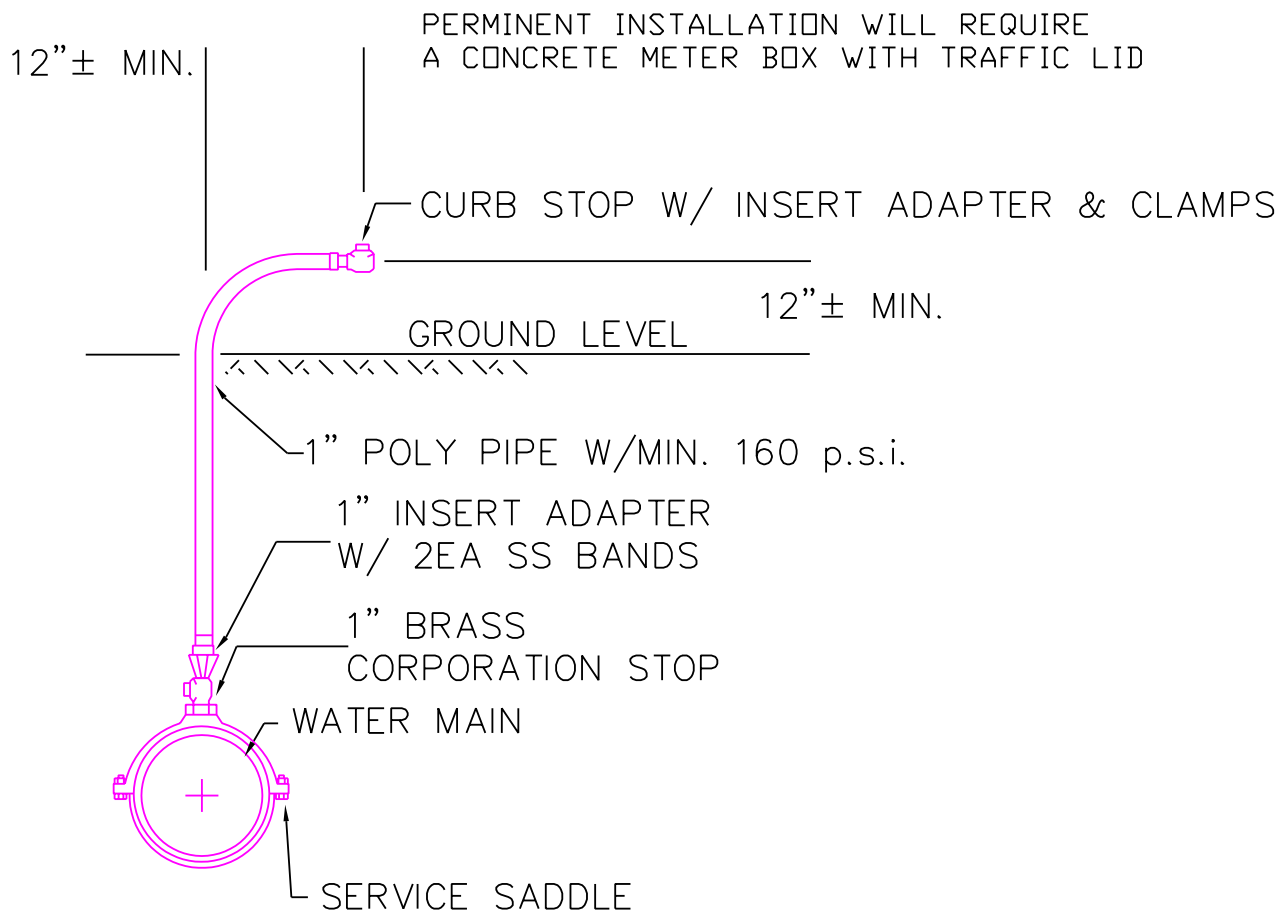

SPECIFATATIONS:

1. SADDLE AND OTHER RELATED PARTS TO BE SAME AS TYPICAL WATER SERVICE ASSEMBLY EXCEPT ROTATE SADDLE 90° UPWARD.
2. 1" POLY-PIPE SHALL BE USED TEMPORARILY AS BLOW OFF FOR AIR RELEASE AND TEST SITE. ONCE TESTING IS COMPLETE, ALL MATERIAL AFTER CORPORATION STOP TO BE REMOVED AND CORPORATION STOP SHUT OFF AND CAPPED.