


VI DRAWINGS & DETAILS

TYPICAL WATER SERVICE 5/8", 3/4" & 1"

DRAWING SUBJECT TO
CHANGE WITHOUT NOTICE.
CONTACT SUMMIT WATER FOR
LATEST DETAILS.

1" WATER METER SERVICE SAME EXCEPT FOR SIZE OF ANGLE STOP, CHECK VALVE & METER

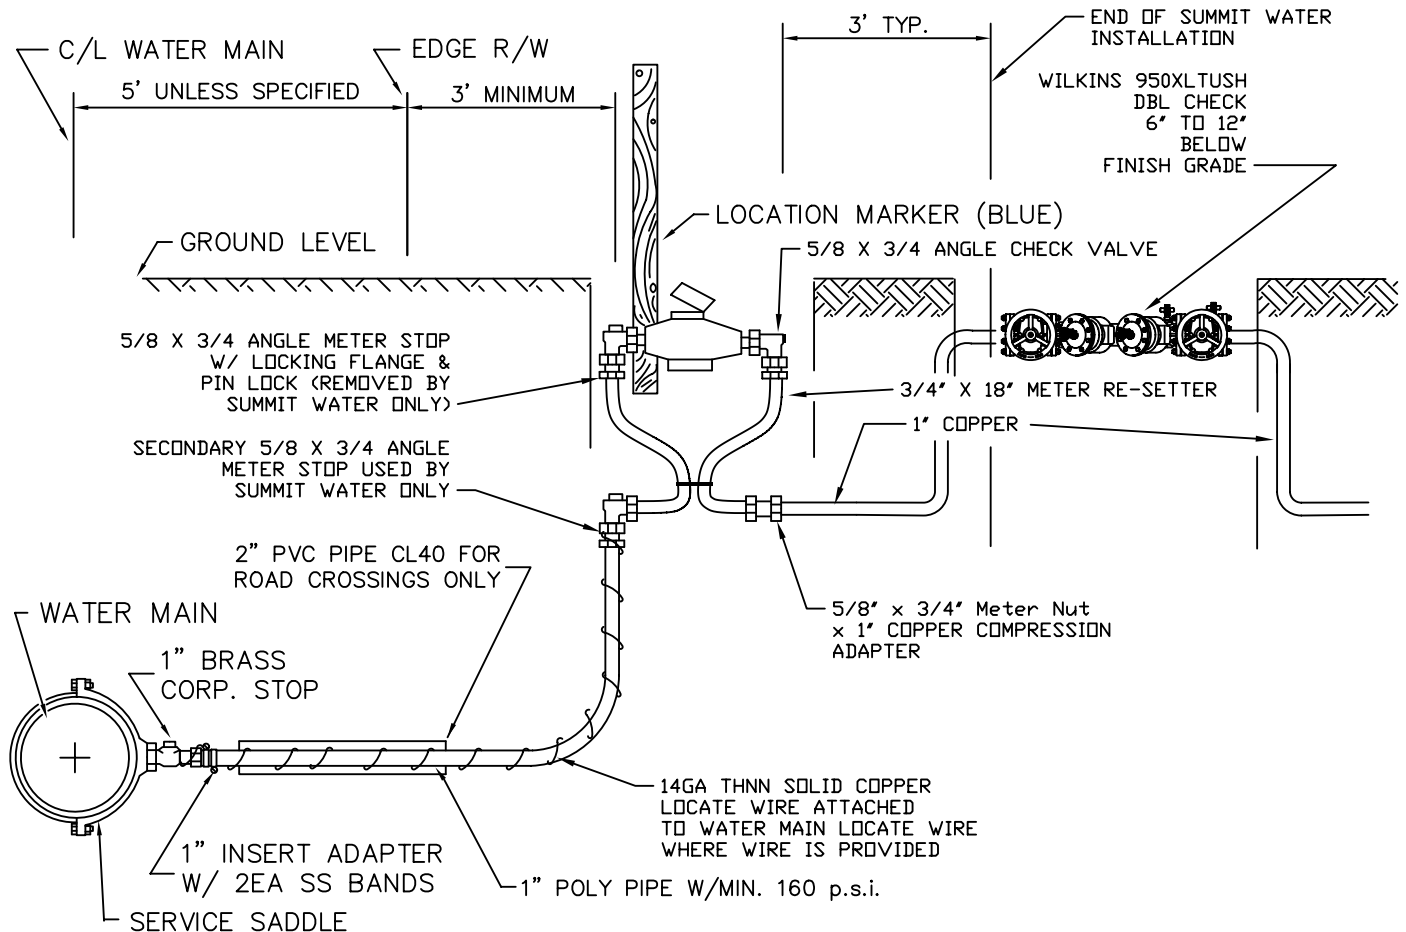

SPECIFICATIONS:

1. METER BOX SHALL BE PLASTIC TYPE w/ DUCTILE IRON READER LID MID-STATES BCF SERIES OR APPROVED EQUAL
2. 1" POLY-PIPE SHALL BE WRAPPED WITH 14 GAUGE SOLID COPPER INSULATED WIRE FOR LOCATING PURPOSES CONNECTED TO LOCATE WIRE AT WATER MAIN IF WIRE IS PRESENT.
3. EACH SERVICE LINE SHALL HAVE A BLUE 2"X2" OR 2"X4" STUD EXTENDING A MINIMUM OF TWO (2) FEET ABOVE GROUND LEVEL. STUD TO BE USED AS A TEMPORARY LOCATION MARKER.
4. ALL WATER SERVICE CROSSINGS SHALL BE IN-CASED IN 2" MIN. SCHD 40 PIPE.
5. WATER LINE FROM DOUBLE CHECK DEVICE TO HOUSE TO BE INSTALLED TO PIERCE COUNTY SPECIFICATIONS AND ORDINANCES
6. DOUBLE CHECK BACKFLOW DEVICE TO BE PAID FOR BY OWNER, INSTALLED BY SUMMIT WATER. DEVICE TO BE INSTALLED IN METER BOX SIM.
7. SUMMIT WATER TO PROVIDE AND INSTALL METER DUE TO REMOTE READ REQUIREMENTS.